

AIR CONDITIONING JOBSITE INFORMATION SHEET

REMEMBER

1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Circle Service Ports used.
4. Saturation Temp. is pressure converted to Temp.

Formula for Super Heat

Vapor Line Temp.

- Minus Sat Temp.

Equals Super Heat

Saturation Temp. _____	Saturation Temp. _____
<div style="border: 1px solid black; border-radius: 50%; width: 40px; height: 40px; margin: 0 auto; display: flex; align-items: center; justify-content: center;"> # </div> <p style="text-align: center; font-size: 10px;">Low PSIG</p>	<div style="border: 1px solid black; border-radius: 50%; width: 40px; height: 40px; margin: 0 auto; display: flex; align-items: center; justify-content: center;"> # </div> <p style="text-align: center; font-size: 10px;">High PSIG</p>

Formula for Sub Cooling

Saturation Temp.

- Minus Liquid Line Temp.

Equals Sub Cooling

Saturation Temp. _____	Saturation Temp. _____
<div style="border: 1px solid black; border-radius: 50%; width: 40px; height: 40px; margin: 0 auto; display: flex; align-items: center; justify-content: center;"> # </div> <p style="text-align: center; font-size: 10px;">Low PSIG</p>	<div style="border: 1px solid black; border-radius: 50%; width: 40px; height: 40px; margin: 0 auto; display: flex; align-items: center; justify-content: center;"> # </div> <p style="text-align: center; font-size: 10px;">High PSIG</p>


Water

Flow _____ **GPM** In

_____ **GPM** Out

Temp. _____ In

_____ Out

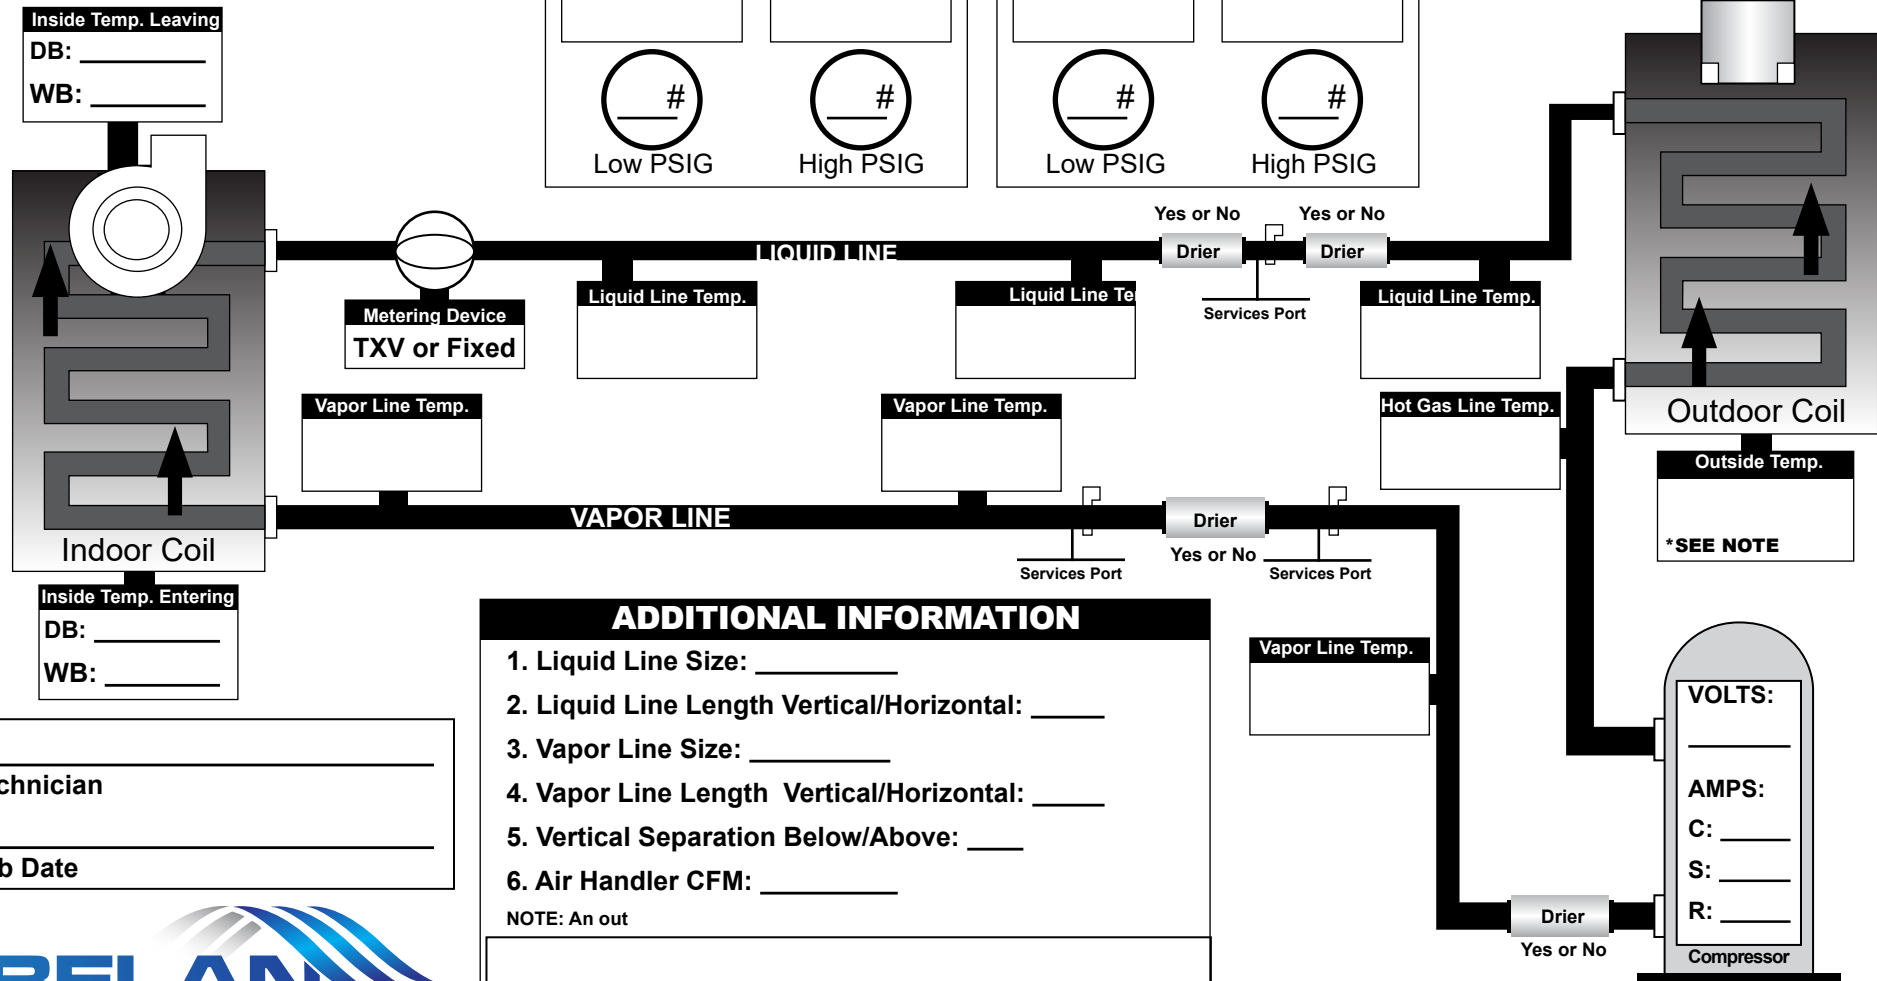

ADDITIONAL INFORMATION

1. Liquid Line Size: _____
2. Liquid Line Length Vertical/Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length Vertical/Horizontal: _____
5. Vertical Separation Below/Above: _____
6. Air Handler CFM: _____

NOTE: An out

Customer Name

Technician

Job Date

